



Albertville Most Common Repair Orders

Small Town Living. Big City Life. **APARTMENT COMPLEXES - 4 OR MORE UNITS**

*This is **not** a complete list of all deficiencies that may be found during the inspection. If you have any questions about this list or other requirements for your inspection, please call your housing inspector.*

FIRE PREVENTION

- **Missing, inoperable or improperly located smoke alarms.**

Groups R-2, R-3, R-4 and I-1. Single or multiple-station smoke alarms shall be installed and maintained in Groups R-2, R-3, R-4 and I-1 regardless of occupant load at all of the following locations:

1. On the ceiling or wall outside of each separate sleeping area in the immediate vicinity of bedrooms.
2. In each room used for sleeping purposes.

- **Fire extinguishers shall be serviced annually by a professional company** (including boiler rooms). MNFC 906.2/NFPA 7.3
- **Store combustible items not closer than 2 feet from the ceiling and not closer than 18 inches from any sprinkler head.** IPMC 701.2/MNFC 315.3.1
- **Exit signs illuminated and back-up power functioning** (replace dead or low batteries). IPMC 701.2/MNFC 1027
- **Inoperable emergency back-up light** (replace batteries or emergency lighting unit). IPMC 701.2/MNFC 1027
- **Remove items from hallway so that there is a clear exit path (minimum of 28" wide) from all rooms to the front door.** IPMC 702.1/MNFC 1104/MNBC 1021
- **Move all storage a minimum of 3 feet from around the furnace, water heater, water meter, electric panel and gas meter.** IPMC 603.3/NEC 110.32
- **Repair locks and doors, including patio doors and storm doors, to function as designed.** IPMC 304.15
- **Fire separation not maintained.** Seal all penetrations in fire walls and ceilings using ½" gypsum & UL-1479, ASTM E-814 fire caulk. (**Do not use foam—no foam is approved for this application.**) In the enclosed space under stairs, install ½" gypsum to the underside of the stairs and supporting stud walls. MNFC 703.1
- **Fire rated doors must self-close and latch.** (Apartment unit doors are fire-rated and are not allowed to be propped open.) IPMC 304.15, 703.2/ MNFC 703.2
- **Remove excessive combustible materials from building and garage and properly store or dispose.** MNFC 315 & Chapter 23
- **Emergency escape openings/windows.** Required emergency escape openings must be maintained in accordance with the code in effect at the time of construction. Minimum net clear opening size must comply with the code that was in effect at the time of construction. **Windows must hold up unassisted and lock properly.** IPMC 702.4/304.13
*No beds permitted in any room that does not have proper fire egress directly from that room (**typically found in basements**).*
- **All residential units: Smoke detectors are required to be replaced in all residential units after 10 years, maintaining the type of detection system in place** (e.g. wired to the unit/building electrical system with battery backup) per NFPA 72 and smoke detector manufacturers specifications.
- **Patio homes and condominiums (R-3 occupancies): A portable fire extinguisher 2A10BC or larger is required at least 4 inches from the floor and no higher than 5 feet for extinguishers weighing less than 40 pounds.** They must be within 75 feet of the dwelling unit in a condominium building (in hallways on the same level). These are required to be serviced annually by a certified individual from an approved organization or replaced annually with a new model. MNFC 906.2.1

INTERIOR

- **Interior surfaces must be free from defects** (peeling or missing paint, discolored, deteriorated or missing caulk or grout, water damage, cracks, holes, etc). Windows must not have broken, missing or cracked glazing materials, and must hold up unassisted when open. IPMC 305.3
- **Tighten handrails and guardrails (interior and exterior).** IPMC 304.13/IPMC 305.5

- **Repair stairs and walking surfaces to be free from defects** (missing or rotted wood, torn, loose or missing carpet or vinyl, etc). IPMC 305.4
- **Doors and door hardware must be maintained in good condition and function properly** (including storm doors and closet doors). IPMC 304.15
- **Insect screens must be in good condition, proper fitting & provided for all windows; storm doors and deck/patio doors in habitable rooms between May 1 and October 1.** IPMC 304.14 (If they are in place during the


PLUMBING AND MECHANICAL

- **Combustion air grate must be unobstructed** (grates, openings are free of debris). IPMC 603.5
- **Maintain 30" clear workspace in front of furnaces, boilers, water heaters (and 15" on either side).** IPMC 603.3/MN Mechanical & Fuel Gas Code 306.1
- **Maintain effective and operable heating controls** (thermostat must function properly). IPMC 603.4
- **Label gas shut off valves going to individual units with a tag inside mechanical room.** MN Mechanical & Fuel Gas Code 409.3
- **Heat required: must supply sufficient heat at a minimum of 68°F during the period of October 1 to May 1.** IPMC 602.3 *Ovens are not permitted to be used as a source of heat.*
- **Mechanical equipment/appliances must be installed and maintained per the manufacturer's specifications to perform as intended.** Forced air and gravity furnaces are required to be professionally serviced every 2 years (using attached HVAC form) if they are over 5 years old.
 - Fuel-burning equipment/appliances are properly connected to an approved chimney or vent. IPMC 603.2
 - Maintain effective safety controls. Plug valves on gas pipes are required to be changed to new valves when appliances or connectors attached to them are changed/upgraded. This must be done by a licensed plumber and a permit is required at the City per state statute. IPMC 603.4
 - Maintain clearances IPMC 603.3
 - Provide combustion air IPMC 603.5
 - Fuel saving devices are properly labeled and approved IPMC 603.6
 - Maintain duct systems free of obstructions IPMC 606.1

inspection, they must fit and be in good condition any time of year).

- **Carbon monoxide alarms required in all single family home and multifamily dwelling units.** All CO alarms must be certified by nationally recognized testing laboratories that conform to UL2034. CO alarms must be located within 10 feet of each sleeping room. Carbon monoxide detectors must be replaced every 5-7 years. Rely on the manufacturer's instructions for exact specifications. MN State Statute 299F.50

- Post copy of current boiler's operator's license and log inside boiler room (where required). MN State Statute 5225.0900
- **No plastic or flexible dryer vents are allowed.** UL-listed and labeled vents are the only ones allowed by code. ensure the vents are securely connected at each section with heat rated tape (not cloth duct tape or aluminum foil) and free of dryer lint. Remove any accumulation of dryer lint on the floor, walls and joist cavity behind the dryer. IPMC 603.1/MN Mechanical, Fuel Gas and Plumbing Code Section 504
- **Clothes dryers are properly vented to the exterior of the building and independent of all other systems.** IPMC 403.5
- **Water contamination:** Remove hose and threads on faucet/spigot (laundry tubs, hose bibs, etc) or install an approved anti-siphon device. Hand held shower wands must have a built-in anti siphon device or one must be installed. Water softener drain tubes must be elevated and supported 1½" from the flood rim or floor drain surface. Dishwasher drain tubes must be elevated and clamped to the highest point under the sink and above the sink drain. The toilet fill valve tube must be

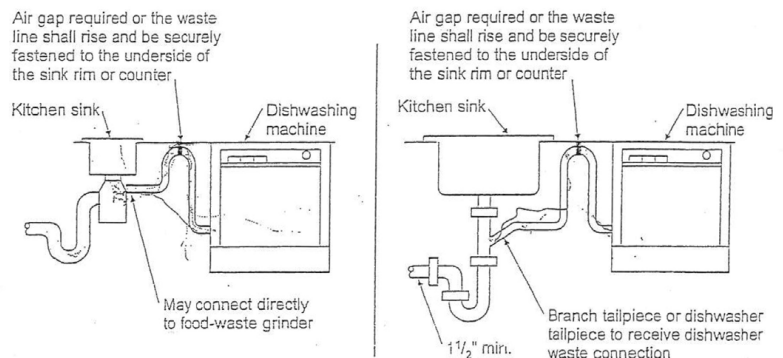

For SI: 1 inch = 25.4 mm.

Dishwasher waste connections

1" above the overflow pipe/tube by use of an angle adapter. IPMC 505.2

- **Plumbing system & fixtures must be installed & maintained in a safe, sanitary, functional condition and are free from leaks.** IPMC 504.1 & 504.3
- **Water system is free from hazards** (no flex pipes under sinks in place of solid pipe, s traps or unvented plumbing). Dishwasher drain line must be installed per illustration and the toilet tank must have the angle adapter clip above the fill valve to create a 1" air gap (see illustration on next page). Water softener drain lines must be elevated and clamped 1½" above the floor drain or laundry tub spill line. IPMC 504.3
- **Water supply:**
 - An adequate amount of water must be supplied. IPMC 505.3
 - Water heats to a minimum of 110°F at all fixtures. IPMC 505.4
- **Water connection:** water system is connected to an approved public or private system. IPMC 505.1


SANITATION

- **Maintain structure and equipment in good repair, structurally sound and in a sanitary condition** (owner's responsibility). IPMC 305.1
- **Maintain a clean and sanitary dwelling unit.** This includes, but is not restricted to floors, counters, stove tops and under burners, sinks, toilets, tubs, walls and cat boxes (**tenant's responsibility**). IPMC 305.1
- **Maintain structures and dwelling units free from insects (including fruit flies) and rodents.** Professional exterminator must be used. IPMC 308.1

ELECTRICAL

- **All electrical equipment, wiring and appliances must be properly installed and maintained in a safe and approved manner.** Replace broken or missing outlet or switch plate covers, broken outlets, outlets with loose connections, improperly wired outlets or switches and all outlets that are painted over. Secure all loose outlets to the junction boxes and the plates to the outlets. IPMC 605.1 A licensed electrical contractor is required to do all electrical repairs or fixture and outlet replacements in a rental unit.
- **Provide electricity to every occupied building.** IPMC 604.1
A minimum service of 60 amps 120/240 volt,

- **Bathrooms & toilet rooms** must have an open-able window with a screen or mechanical ventilation fan in the bathroom that is properly vented to the exterior. Clean bathroom ventilation grate and fan or air circulation vent diffuser so they are free from debris and function properly. IPMC 403.2 Location must provide privacy and not constitute the only passageway to a hall or other space, or to the exterior. IPMC 503.1
- **Sanitary drainage system must be maintained free from obstructions, leaks and defects.** IPMC 506.2

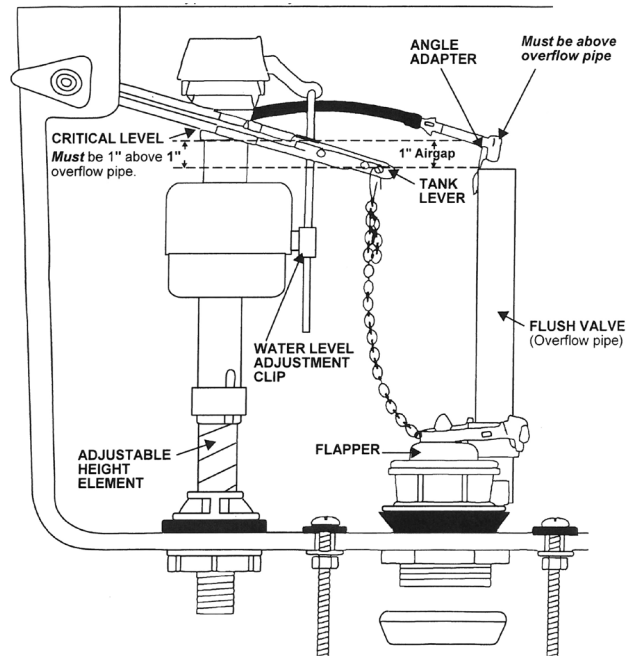

TOILET TANK ELEMENTS

NOTE: The critical element in the installation is to provide a minimum of 1 inch air gap. This prevents the water in the tank from being siphoned into the house drinking water.

- single phase electrical service is required for dwelling units. IPMC 604.2
- **Every habitable space in a dwelling must contain at least two separate receptacle outlets.** Every laundry area must contain at least one grounded-type receptacle with a ground fault circuit interrupter (GFCI). Every bathroom must contain at least one receptacle. Any new bathroom receptacle outlet shall have GFCI protection. IPMC 605.2/NEC 406.4

- **Lighting must be provided in every public hall, interior stairway, toilet room, kitchen, bathroom, laundry room, boiler room, furnace room, and means of egress, including external stairway.** IPMC 402.2 There cannot be any open sockets in any fixtures in an area where water is used, and light pulls must be non-metal in these areas (basements, kitchens and baths). IPMC 605.3/NEC 411 *(All lights must come on with the corresponding switch or pull).*

EXTERIOR

- **Maintain exterior property and premises in a clean, safe and sanitary condition.** IPMC 302.1
 - **Maintain all structures and exterior property free from rodent harborage and infestations.** IPMC 302.5
 - **Provide adequate garbage & recycling facilities.**
Remove any refuse, litter and garbage from the property that is not inside an approved waste receptacle.
 - **Maintain premises' grading to prevent the erosion of soil and to prevent the accumulation of stagnant water thereon, or within any structure located thereon.** IPMC 302.2
 - **Roofs and flashing must be sound, tight and not have any defects that admit rain.** Make sure gutters are clean, not leaking and all downspouts and extensions securely attached and not damaged. IPMC 304.7 Drainage of roofs and paved areas, yard and courts, and other open areas on the premises must not be discharged in a manner that creates a public nuisance.
 - **Walls must be free from holes, breaks, loose or rotting materials, peeling paint, and maintained weatherproof and properly coated to prevent deterioration.** IPMC 304.6
Protective treatment is required on exterior wood surfaces, siding and masonry joints, metal surfaces. IPMC 304.2
 - **Exterior structural members must be maintained free from deterioration, and must be capable of safely supporting the imposed dead and live loads.** IPMC 304.4
(This includes stucco and foundation block as well as siding.)
 - **Foundation walls must be maintained in good repair, structurally sound and sanitary so as not to pose a threat to the public health, safety or welfare.** Seal all cracks and separations with a mortar sealant. IPMC 304.5
 - **Decorative features (cornices, belt courses, corbels, terra cotta trim, wall facings, similar decorative features) must be maintained in good repair with proper anchorage and in safe condition.** IPMC 304.8
 - **No extension cords or plug adapters shall be used in lieu of permanent wiring.** Replace all non surge protected adapters and extension cords with UL listed surge protected strips and adapters. Section 405 IPMC 604.3/MNFC 605.5
 - **Maintain 3 feet clear works space in front of electrical panel.** NEC 110.32
-
- **Address numbers required on the side of the building facing the right-of-way** (front of house; on garage facing alley; or, if no garage present, on rear of house, too). Numbers shall be a minimum of 4 inches high, may not exceed 1 foot in height, and shall be 1/2" width stroke on contrasting background.
 - **Accessory structures must be maintained structurally sound and in good repair.** These include, but are not limited to, detached garages, sheds, fences and walls. IPMC 302.7
 - **Chimneys & towers (smoke stacks, etc) must be maintained structurally safe and sound, and in good repair.** Replace or repair missing and loose bricks and mortar or any other defects that are noted. IPMC 304.11
 - **Sidewalks, garage floors and driveways must be kept in a proper state of repair, free from hazardous conditions, and maintained.** This includes, loose, missing, spalling or heaving concrete and asphalt that create an uneven or unstable walking surface. IPMC 302.3
 - **Windows, skylights and door frames must be kept in sound condition, good repair and weather tight.** IPMC 303.13 . Open-able windows must be easily open-able and capable of being held in position by window hardware (not with sticks or other props). IPMC 304.13.2
Maintain all glazing free from cracks and holes. IPMC 304.13.1
 - **Structural members must be maintained free from deterioration, and must be capable of safely supporting the imposed dead and live loads.** IPMC 304.4
 - **Remove graffiti from property.**
 - **Remove junk vehicles** or store inside an enclosed building or obtain current tabs and ensure that they are operable.
 - **Remove all litter and prohibited open storage.**

MINNESOTA DEPT OF LABOR & INDUSTRY - SMOKE DETECTORS STATUTES

299 F.362 SMOKE DETECTOR; INSTALLATION; RULES; PENALTY.

- **Subd. 5. Maintenance Responsibilities.** For all occupancies covered by this section where the occupant is not the owner of the dwelling unit or the guest room, *the owner is responsible for maintenance of the smoke detectors.* An owner may file inspection and maintenance reports with the local fire marshal for establishing evidence of inspection and maintenance of smoke detectors.
- **Subd. 5a. Inform Owner; No Added Liability.** *The occupant of a dwelling unit must inform the owner of the dwelling unit of a nonfunctioning smoke detector within 24 hours of discovering that the smoke detector in the dwelling unit is not functioning.* If the occupant fails to inform the owner under this subdivision, the occupant's liability for damages is not greater than it otherwise would be.
- **Subd. 6. Penalties.** *(a) Any person who violates any provision of this section shall be subject to the same penalty and the enforcement mechanism that is provided for violation of the State Fire Code, as specified in section 299F.011, subdivision 6. (b) An occupant who willfully disables a smoke detector or causes it to be nonfunctioning, resulting in damage or injury to persons or property, is guilty of a misdemeanor.*